

CERTIFICATE OF ANALYSIS

REPORTED TO	Yukon Government - Department of Education 1000 Lewes Blvd. Whitehorse, YT Y1A 6N2	WORK ORDER	9080891
ATTENTION	Trevor Justason	RECEIVED / TEMP REPORTED	2019-08-12 10:30 / 10°C 2019-08-20 08:36
PO NUMBER			
PROJECT	Department of Education 2019 Water Testing Program		
PROJECT INFO	Contract No. C00044694 (Elijah Smith School)		

Introduction:

CARO Analytical Services is a testing laboratory full of smart, engaged scientists driven to make the world a safer and healthier place. Through our clients' projects we become an essential element for a better world. We employ methods conducted in accordance with recognized professional standards using accepted testing methodologies and quality control efforts. CARO is accredited by the Canadian Association for Laboratories Accreditation (CALA) to ISO 17025:2005 for specific tests listed in the scope of accreditation approved by CALA.

Big Picture Sidekicks



You know that the sample you collected after snowshoeing to site, digging 5 meters, and racing to get it on a plane so you can submit it to the lab for time sensitive results needed to make important and expensive decisions (whew) is VERY important. We know that too.

We've Got Chemistry



It's simple. We figure the more you enjoy working with our fun and engaged team members; the more likely you are to give us continued opportunities to support you.

Ahead of the Curve



Through research, regulation knowledge, and instrumentation, we are your analytical centre for the technical knowledge you need, BEFORE you need it, so you can stay up to date and in the know.


If you have any questions or concerns, please contact me at bshaw@caro.ca

Authorized By:

Bryan Shaw, Ph.D., P.Chem.
Client Service Coordinator

1-888-311-8846 | www.caro.ca

#110 4011 Viking Way Richmond, BC V6V 2K9 | #102 3677 Highway 97N Kelowna, BC V1X 5C3 | 17225 109 Avenue Edmonton, AB T5S 1H7

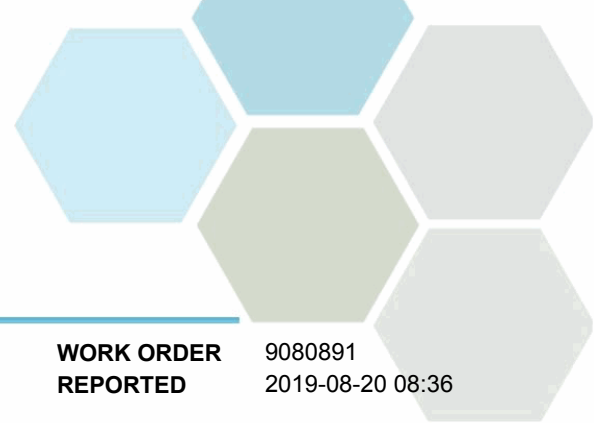


TEST RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL	Units	Analyzed	Qualifier
KS1 (9080891-01) Matrix: Water Sampled: 2019-08-06 13:03					
<i>Total Metals</i>					
Lead, total	2.53	0.20	µg/L	2019-08-18	
KS2 (9080891-02) Matrix: Water Sampled: 2019-08-06 13:03					
<i>Total Metals</i>					
Lead, total	3.19	0.20	µg/L	2019-08-18	
KS1 Tier 2 (9080891-03) Matrix: Water Sampled: 2019-08-06 13:05					
<i>Total Metals</i>					
Lead, total	< 0.20	0.20	µg/L	2019-08-18	
DF1 (9080891-04) Matrix: Water Sampled: 2019-08-06 13:07					
<i>Total Metals</i>					
Lead, total	0.22	0.20	µg/L	2019-08-18	
BS1 (9080891-05) Matrix: Water Sampled: 2019-08-06 13:11					
<i>Total Metals</i>					
Lead, total	0.70	0.20	µg/L	2019-08-18	
BS2 (9080891-06) Matrix: Water Sampled: 2019-08-06 13:11					
<i>Total Metals</i>					
Lead, total	1.75	0.20	µg/L	2019-08-18	
BS3 (9080891-07) Matrix: Water Sampled: 2019-08-06 13:14					
<i>Total Metals</i>					
Lead, total	1.56	0.20	µg/L	2019-08-18	
BS4 (9080891-08) Matrix: Water Sampled: 2019-08-06 13:14					
<i>Total Metals</i>					
Lead, total	0.40	0.20	µg/L	2019-08-18	
DF2 (9080891-09) Matrix: Water Sampled: 2019-08-06 13:14					
<i>Total Metals</i>					

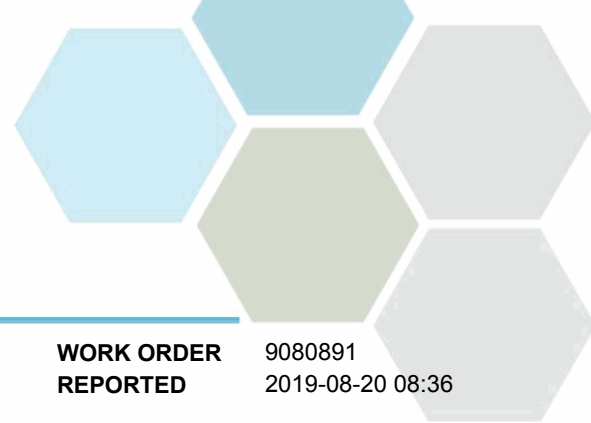


TEST RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL	Units	Analyzed	Qualifier
DF2 (9080891-09) Matrix: Water Sampled: 2019-08-06 13:14, Continued					
<i>Total Metals, Continued</i>					
Lead, total	0.45	0.20	µg/L	2019-08-18	
CS1 (9080891-10) Matrix: Water Sampled: 2019-08-06 13:19					
<i>Total Metals</i>					
Lead, total	2.56	0.20	µg/L	2019-08-18	
DF4 (9080891-11) Matrix: Water Sampled: 2019-08-06 13:19					
<i>Total Metals</i>					
Lead, total	8.32	0.20	µg/L	2019-08-18	
CS2 (9080891-12) Matrix: Water Sampled: 2019-08-06 13:19					
<i>Total Metals</i>					
Lead, total	11.2	0.20	µg/L	2019-08-18	
DF3 (9080891-13) Matrix: Water Sampled: 2019-08-06 13:19					
<i>Total Metals</i>					
Lead, total	15.9	0.20	µg/L	2019-08-18	
BS5 (9080891-14) Matrix: Water Sampled: 2019-08-06 13:28					
<i>Total Metals</i>					
Lead, total	0.99	0.20	µg/L	2019-08-18	
BS6 (9080891-15) Matrix: Water Sampled: 2019-08-06 13:31					
<i>Total Metals</i>					
Lead, total	0.52	0.20	µg/L	2019-08-18	
BS7 (9080891-16) Matrix: Water Sampled: 2019-08-06 13:31					
<i>Total Metals</i>					
Lead, total	0.79	0.20	µg/L	2019-08-18	
KS3 (9080891-17) Matrix: Water Sampled: 2019-08-06 13:31					
<i>Total Metals</i>					

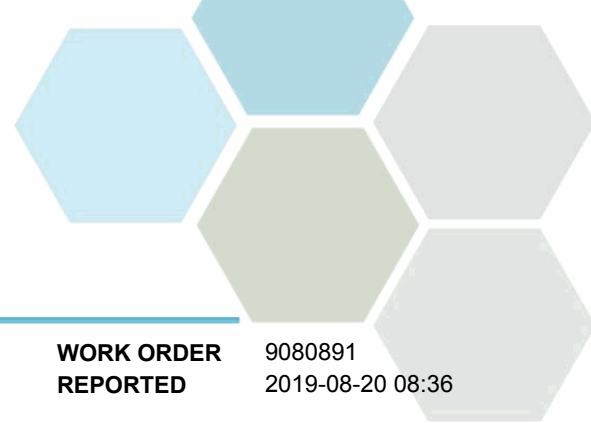


TEST RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL	Units	Analyzed	Qualifier
KS3 (9080891-17) Matrix: Water Sampled: 2019-08-06 13:31, Continued					
<i>Total Metals, Continued</i>					
Lead, total	0.62	0.20	µg/L	2019-08-18	
KS3 Tier 2 (9080891-18) Matrix: Water Sampled: 2019-08-06 13:31					
<i>Total Metals</i>					
Lead, total	< 0.20	0.20	µg/L	2019-08-18	
DF5 (9080891-19) Matrix: Water Sampled: 2019-08-06 13:38					
<i>Total Metals</i>					
Lead, total	< 0.20	0.20	µg/L	2019-08-18	
DF6 (9080891-20) Matrix: Water Sampled: 2019-08-06 13:38					
<i>Total Metals</i>					
Lead, total	14.5	0.20	µg/L	2019-08-18	
CS3 (9080891-21) Matrix: Water Sampled: 2019-08-06 13:38					
<i>Total Metals</i>					
Lead, total	1.42	0.20	µg/L	2019-08-18	
BS8 (9080891-22) Matrix: Water Sampled: 2019-08-06 13:43					
<i>Total Metals</i>					
Lead, total	2.94	0.20	µg/L	2019-08-18	
BS9 (9080891-23) Matrix: Water Sampled: 2019-08-06 13:43					
<i>Total Metals</i>					
Lead, total	1.35	0.20	µg/L	2019-08-18	
BS10 (9080891-24) Matrix: Water Sampled: 2019-08-06 13:43					
<i>Total Metals</i>					
Lead, total	3.92	0.20	µg/L	2019-08-18	
DF7 (9080891-25) Matrix: Water Sampled: 2019-08-06 13:46					
<i>Total Metals</i>					

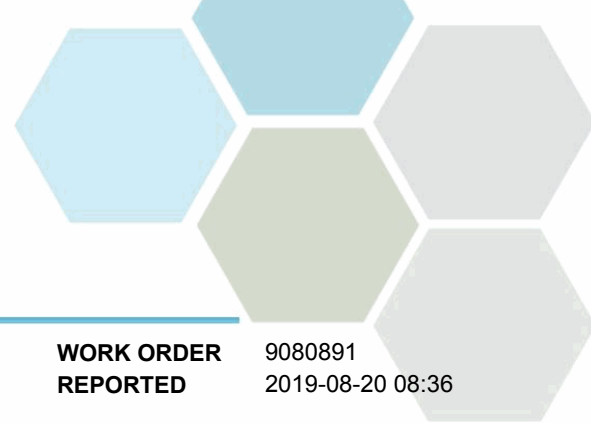


TEST RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL	Units	Analyzed	Qualifier
DF7 (9080891-25) Matrix: Water Sampled: 2019-08-06 13:46, Continued					
<i>Total Metals, Continued</i>					
Lead, total	8.85	0.20	µg/L	2019-08-18	
CS4 (9080891-26) Matrix: Water Sampled: 2019-08-06 13:46					
<i>Total Metals</i>					
Lead, total	3.78	0.20	µg/L	2019-08-18	
DF8 (9080891-27) Matrix: Water Sampled: 2019-08-06 13:49					
<i>Total Metals</i>					
Lead, total	12.0	0.20	µg/L	2019-08-18	
CS5 (9080891-28) Matrix: Water Sampled: 2019-08-06 13:49					
<i>Total Metals</i>					
Lead, total	2.00	0.20	µg/L	2019-08-18	
BS11 (9080891-29) Matrix: Water Sampled: 2019-08-06 13:49					
<i>Total Metals</i>					
Lead, total	3.02	0.20	µg/L	2019-08-18	
BS12 (9080891-30) Matrix: Water Sampled: 2019-08-06 13:53					
<i>Total Metals</i>					
Lead, total	1.50	0.20	µg/L	2019-08-18	
BS13 (9080891-31) Matrix: Water Sampled: 2019-08-06 13:53					
<i>Total Metals</i>					
Lead, total	1.72	0.20	µg/L	2019-08-18	
BS14 (9080891-32) Matrix: Water Sampled: 2019-08-06 13:55					
<i>Total Metals</i>					
Lead, total	0.91	0.20	µg/L	2019-08-18	
DF9 (9080891-33) Matrix: Water Sampled: 2019-08-06 13:55					
<i>Total Metals</i>					

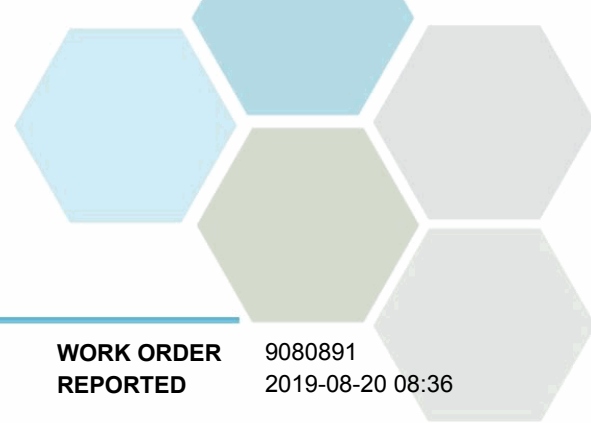


TEST RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL	Units	Analyzed	Qualifier
DF9 (9080891-33) Matrix: Water Sampled: 2019-08-06 13:55, Continued					
<i>Total Metals, Continued</i>					
Lead, total	20.2	0.20	µg/L	2019-08-18	
CS6 (9080891-34) Matrix: Water Sampled: 2019-08-06 13:55					
<i>Total Metals</i>					
Lead, total	3.97	0.20	µg/L	2019-08-18	
CS7 (9080891-35) Matrix: Water Sampled: 2019-08-06 14:00					
<i>Total Metals</i>					
Lead, total	3.22	0.20	µg/L	2019-08-18	
DF10 (9080891-36) Matrix: Water Sampled: 2019-08-06 14:00					
<i>Total Metals</i>					
Lead, total	7.70	0.20	µg/L	2019-08-18	
CS8 (9080891-37) Matrix: Water Sampled: 2019-08-06 14:02					
<i>Total Metals</i>					
Lead, total	2.26	0.20	µg/L	2019-08-18	
DF11 (9080891-38) Matrix: Water Sampled: 2019-08-06 14:02					
<i>Total Metals</i>					
Lead, total	25.0	0.20	µg/L	2019-08-18	
BS15 (9080891-39) Matrix: Water Sampled: 2019-08-06 14:05					
<i>Total Metals</i>					
Lead, total	2.09	0.20	µg/L	2019-08-18	
BS16 (9080891-40) Matrix: Water Sampled: 2019-08-06 14:05					
<i>Total Metals</i>					
Lead, total	12.0	0.20	µg/L	2019-08-18	
BS17 (9080891-41) Matrix: Water Sampled: 2019-08-06 14:05					
<i>Total Metals</i>					

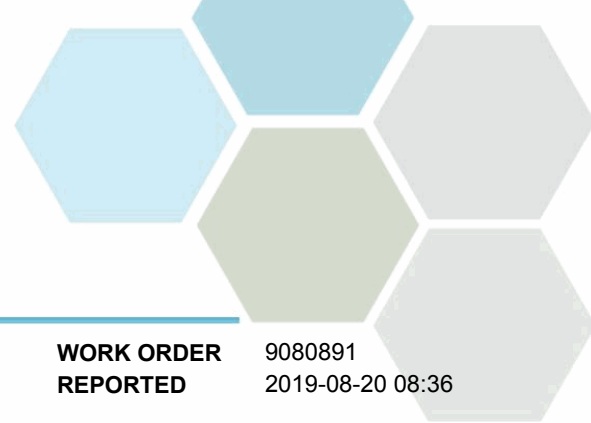


TEST RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL	Units	Analyzed	Qualifier
BS17 (9080891-41) Matrix: Water Sampled: 2019-08-06 14:05, Continued					
<i>Total Metals, Continued</i>					
Lead, total	2.14	0.20	µg/L	2019-08-18	
CS9 (9080891-42) Matrix: Water Sampled: 2019-08-06 14:09					
<i>Total Metals</i>					
Lead, total	3.12	0.20	µg/L	2019-08-18	
DF12 (9080891-43) Matrix: Water Sampled: 2019-08-06 14:09					
<i>Total Metals</i>					
Lead, total	43.4	0.20	µg/L	2019-08-18	
CS10 (9080891-44) Matrix: Water Sampled: 2019-08-06 14:12					
<i>Total Metals</i>					
Lead, total	5.70	0.20	µg/L	2019-08-18	
DF13 (9080891-45) Matrix: Water Sampled: 2019-08-06 14:12					
<i>Total Metals</i>					
Lead, total	43.8	0.20	µg/L	2019-08-18	
CS12 (9080891-46) Matrix: Water Sampled: 2019-08-06 14:16					
<i>Total Metals</i>					
Lead, total	2.83	0.20	µg/L	2019-08-18	
DF15 (9080891-47) Matrix: Water Sampled: 2019-08-06 14:16					
<i>Total Metals</i>					
Lead, total	2.56	0.20	µg/L	2019-08-18	
CS13 (9080891-48) Matrix: Water Sampled: 2019-08-06 14:16					
<i>Total Metals</i>					
Lead, total	5.10	0.20	µg/L	2019-08-18	
DF16 (9080891-49) Matrix: Water Sampled: 2019-08-06 14:16					
<i>Total Metals</i>					

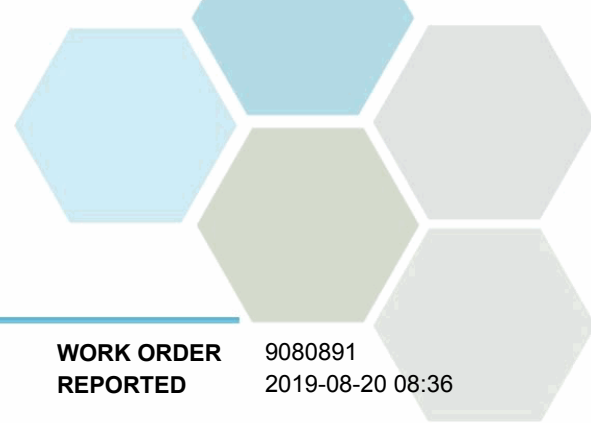


TEST RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL	Units	Analyzed	Qualifier
DF16 (9080891-49) Matrix: Water Sampled: 2019-08-06 14:16, Continued					
<i>Total Metals, Continued</i>					
Lead, total	6.20	0.20	µg/L	2019-08-18	
CS14 (9080891-50) Matrix: Water Sampled: 2019-08-06 14:16					
<i>Total Metals</i>					
Lead, total	2.48	0.20	µg/L	2019-08-18	
DF17 (9080891-51) Matrix: Water Sampled: 2019-08-06 14:16					
<i>Total Metals</i>					
Lead, total	10.6	0.20	µg/L	2019-08-18	
BS18 (9080891-52) Matrix: Water Sampled: 2019-08-06 14:16					
<i>Total Metals</i>					
Lead, total	0.60	0.20	µg/L	2019-08-18	
BS19 (9080891-53) Matrix: Water Sampled: 2019-08-06 14:33					
<i>Total Metals</i>					
Lead, total	1.15	0.20	µg/L	2019-08-18	
CS15 (9080891-54) Matrix: Water Sampled: 2019-08-06 14:33					
<i>Total Metals</i>					
Lead, total	4.19	0.20	µg/L	2019-08-18	
CS18 (9080891-55) Matrix: Water Sampled: 2019-08-06 14:29					
<i>Total Metals</i>					
Lead, total	1.76	0.20	µg/L	2019-08-19	
DF19 (9080891-56) Matrix: Water Sampled: 2019-08-06 14:29					
<i>Total Metals</i>					
Lead, total	16.1	0.20	µg/L	2019-08-19	
DF20 (9080891-57) Matrix: Water Sampled: 2019-08-06 14:35					
<i>Total Metals</i>					

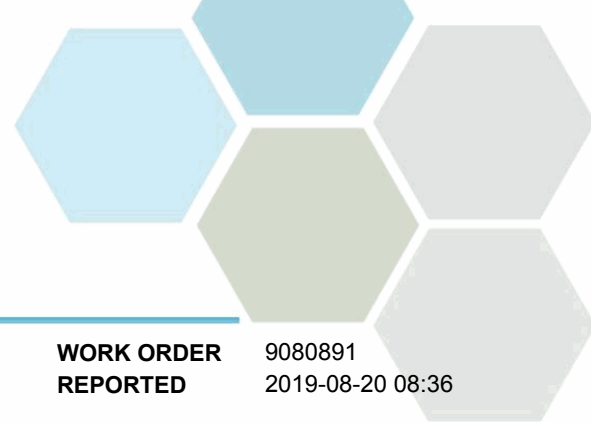


TEST RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL	Units	Analyzed	Qualifier
DF20 (9080891-57) Matrix: Water Sampled: 2019-08-06 14:35, Continued					
<i>Total Metals, Continued</i>					
Lead, total	< 0.20	0.20	µg/L	2019-08-19	
CS16 (9080891-58) Matrix: Water Sampled: 2019-08-06 14:35					
<i>Total Metals</i>					
Lead, total	5.93	0.20	µg/L	2019-08-19	
CS17 (9080891-59) Matrix: Water Sampled: 2019-08-06 14:35					
<i>Total Metals</i>					
Lead, total	2.61	0.20	µg/L	2019-08-19	
DF18 (9080891-60) Matrix: Water Sampled: 2019-08-06 14:30					
<i>Total Metals</i>					
Lead, total	8.91	0.20	µg/L	2019-08-19	
CS19 (9080891-61) Matrix: Water Sampled: 2019-08-06 14:43					
<i>Total Metals</i>					
Lead, total	2.32	0.20	µg/L	2019-08-19	
DF22 (9080891-62) Matrix: Water Sampled: 2019-08-06 14:43					
<i>Total Metals</i>					
Lead, total	< 0.20	0.20	µg/L	2019-08-19	
CS20 (9080891-63) Matrix: Water Sampled: 2019-08-06 14:48					
<i>Total Metals</i>					
Lead, total	3.52	0.20	µg/L	2019-08-19	
DF23 (9080891-64) Matrix: Water Sampled: 2019-08-06 14:50					
<i>Total Metals</i>					
Lead, total	8.56	0.20	µg/L	2019-08-19	
BS20 (9080891-65) Matrix: Water Sampled: 2019-08-06 14:50					
<i>Total Metals</i>					

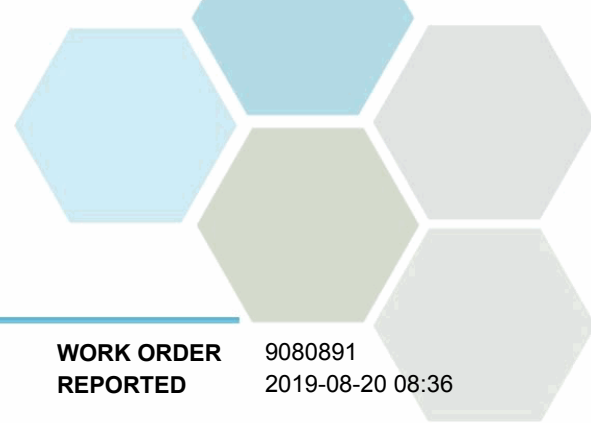


TEST RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL	Units	Analyzed	Qualifier
BS20 (9080891-65) Matrix: Water Sampled: 2019-08-06 14:50, Continued					
<i>Total Metals, Continued</i>					
Lead, total	2.83	0.20	µg/L	2019-08-19	
BS21 (9080891-66) Matrix: Water Sampled: 2019-08-06 14:53					
<i>Total Metals</i>					
Lead, total	3.42	0.20	µg/L	2019-08-19	
BS22 (9080891-67) Matrix: Water Sampled: 2019-08-06 14:53					
<i>Total Metals</i>					
Lead, total	11.0	0.20	µg/L	2019-08-19	
CS21 (9080891-68) Matrix: Water Sampled: 2019-08-06 14:53					
<i>Total Metals</i>					
Lead, total	3.62	0.20	µg/L	2019-08-19	
DF24 (9080891-69) Matrix: Water Sampled: 2019-08-06 14:57					
<i>Total Metals</i>					
Lead, total	6.91	0.20	µg/L	2019-08-19	
CS22 (9080891-70) Matrix: Water Sampled: 2019-08-06 14:57					
<i>Total Metals</i>					
Lead, total	4.56	0.20	µg/L	2019-08-19	
DF25 (9080891-71) Matrix: Water Sampled: 2019-08-06 15:00					
<i>Total Metals</i>					
Lead, total	10.2	0.20	µg/L	2019-08-19	
BS23 (9080891-72) Matrix: Water Sampled: 2019-08-06 15:00					
<i>Total Metals</i>					
Lead, total	2.43	0.20	µg/L	2019-08-19	
BS24 (9080891-73) Matrix: Water Sampled: 2019-08-06 15:03					
<i>Total Metals</i>					

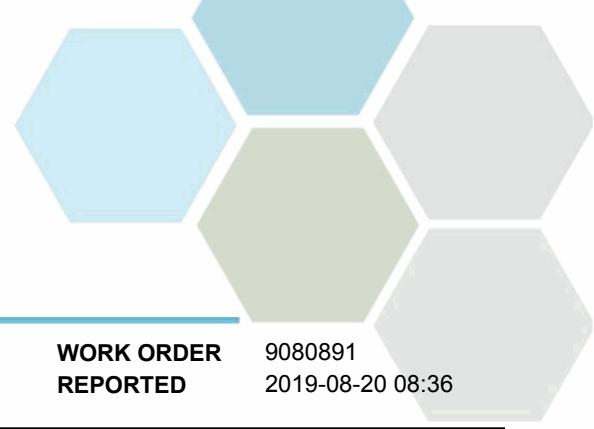


TEST RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL	Units	Analyzed	Qualifier
BS24 (9080891-73) Matrix: Water Sampled: 2019-08-06 15:03, Continued					
<i>Total Metals, Continued</i>					
Lead, total	8.37	0.20	µg/L	2019-08-19	
BS25 (9080891-74) Matrix: Water Sampled: 2019-08-06 15:03					
<i>Total Metals</i>					
Lead, total	5.45	0.20	µg/L	2019-08-19	

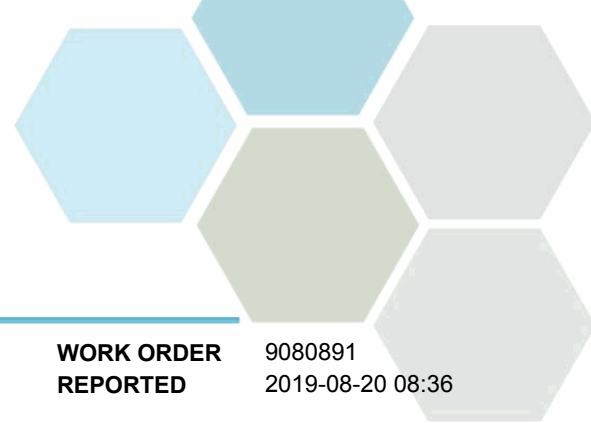

APPENDIX 1: SUPPORTING INFORMATION

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analysis Description	Method Ref.	Technique	Location
Total Metals in Water	EPA 200.2* / EPA 6020B	HNO ₃ +HCl Hot Block Digestion / Inductively Coupled Plasma-Mass Spectroscopy (ICP-MS)	Richmond

Note: An asterisk in the Method Reference indicates that the CARO method has been modified from the reference method


Glossary of Terms:

RL	Reporting Limit (default)
<	Less than the specified Reporting Limit (RL) - the actual RL may be higher than the default RL due to various factors
µg/L	Micrograms per litre
EPA	United States Environmental Protection Agency Test Methods

General Comments:

The results in this report apply to the samples analyzed in accordance with the Chain of Custody document. This analytical report must be reproduced in its entirety. CARO is not responsible for any loss or damage resulting directly or indirectly from error or omission in the conduct of testing. Liability is limited to the cost of analysis. Samples will be disposed of 30 days after the test report has been issued unless otherwise agreed to in writing.

Results in **Bold** indicate values that are above CARO's method reporting limits. Any results that are above regulatory limits are highlighted **red**. Please note that results will only be highlighted red if the regulatory limits are included on the CARO report. Any Bold and/or highlighted results do not take into account method uncertainty. If you would like method uncertainty or regulatory limits to be included on your report, please contact your Account Manager: bshaw@caro.ca

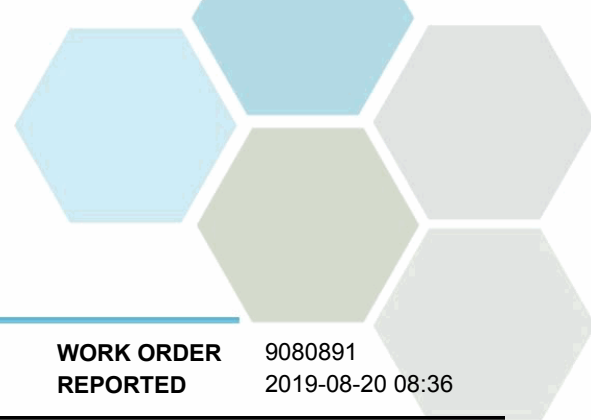

APPENDIX 2: QUALITY CONTROL RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program


WORK ORDER REPORTED 9080891
2019-08-20 08:36

The following section displays the quality control (QC) data that is associated with your sample data. Groups of samples are prepared in "batches" and analyzed in conjunction with QC samples that ensure your data is of the highest quality. Common QC types include:

- **Method Blank (Blk):** A blank sample that undergoes sample processing identical to that carried out for the test samples. Method blank results are used to assess contamination from the laboratory environment and reagents.
- **Duplicate (Dup):** An additional or second portion of a randomly selected sample in the analytical run carried through the entire analytical process. Duplicates provide a measure of the analytical method's precision (reproducibility).
- **Blank Spike (BS):** A sample of known concentration which undergoes processing identical to that carried out for test samples, also referred to as a laboratory control sample (LCS). Blank spikes provide a measure of the analytical method's accuracy.
- **Matrix Spike (MS):** A second aliquot of sample is fortified with with a known concentration of target analytes and carried through the entire analytical process. Matrix spikes evaluate potential matrix effects that may affect the analyte recovery.
- **Reference Material (SRM):** A homogenous material of similar matrix to the samples, certified for the parameter(s) listed. Reference Materials ensure that the analytical process is adequate to achieve acceptable recoveries of the parameter(s) tested.

Each QC type is analyzed at a 5-10% frequency, i.e. one blank/duplicate/spike for every 10-20 samples. For all types of QC, the specified recovery (% Rec) and relative percent difference (RPD) limits are derived from long-term method performance averages and/or prescribed by the reference method.

Analyte	Result	RL Units	Spike Level	Source Result	% REC	REC Limit	% RPD	RPD Limit	Qualifier
Total Metals, Batch B9H1080									
Blank (B9H1080-BLK1)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	< 0.20	0.20 µg/L							
Blank (B9H1080-BLK2)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	< 0.20	0.20 µg/L							
LCS (B9H1080-BS1)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	19.6	0.20 µg/L	20.0		98	80-120			
Reference (B9H1080-SRM1)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	207	0.20 µg/L	204		101	90-110			
Total Metals, Batch B9H1083									
Blank (B9H1083-BLK1)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	< 0.20	0.20 µg/L							
Blank (B9H1083-BLK2)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	< 0.20	0.20 µg/L							
LCS (B9H1083-BS1)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	19.4	0.20 µg/L	20.0		97	80-120			
Duplicate (B9H1083-DUP1)			Source: 9080891-15 Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	0.49	0.20 µg/L		0.52				20	
Reference (B9H1083-SRM1)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	204	0.20 µg/L	204		100	90-110			
Total Metals, Batch B9H1084									
Blank (B9H1084-BLK1)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	< 0.20	0.20 µg/L							
Blank (B9H1084-BLK2)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	< 0.20	0.20 µg/L							

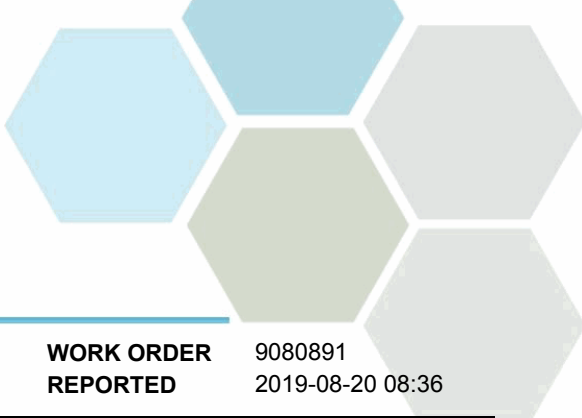

APPENDIX 2: QUALITY CONTROL RESULTS

REPORTED TO PROJECT Yukon Government - Department of Education
Department of Education 2019 Water Testing Program

WORK ORDER REPORTED 9080891
2019-08-20 08:36

Analyte	Result	RL Units	Spike Level	Source Result	% REC	REC Limit	% RPD	RPD Limit	Qualifier
Total Metals, Batch B9H1084, Continued									
LCS (B9H1084-BS1)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	19.8	0.20 µg/L	20.0		99	80-120			
Duplicate (B9H1084-DUP1)			Source: 9080891-35 Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	3.21	0.20 µg/L		3.22			< 1	20	
Reference (B9H1084-SRM1)			Prepared: 2019-08-14, Analyzed: 2019-08-18						
Lead, total	212	0.20 µg/L	204		104	90-110			
Total Metals, Batch B9H1085									
Blank (B9H1085-BLK1)			Prepared: 2019-08-14, Analyzed: 2019-08-19						
Lead, total	< 0.20	0.20 µg/L							
Blank (B9H1085-BLK2)			Prepared: 2019-08-14, Analyzed: 2019-08-19						
Lead, total	< 0.20	0.20 µg/L							
LCS (B9H1085-BS1)			Prepared: 2019-08-14, Analyzed: 2019-08-19						
Lead, total	19.1	0.20 µg/L	20.0		96	80-120			
Duplicate (B9H1085-DUP1)			Source: 9080891-55 Prepared: 2019-08-14, Analyzed: 2019-08-19						
Lead, total	1.70	0.20 µg/L		1.76			3	20	
Reference (B9H1085-SRM1)			Prepared: 2019-08-14, Analyzed: 2019-08-19						
Lead, total	205	0.20 µg/L	204		101	90-110			